


Ver



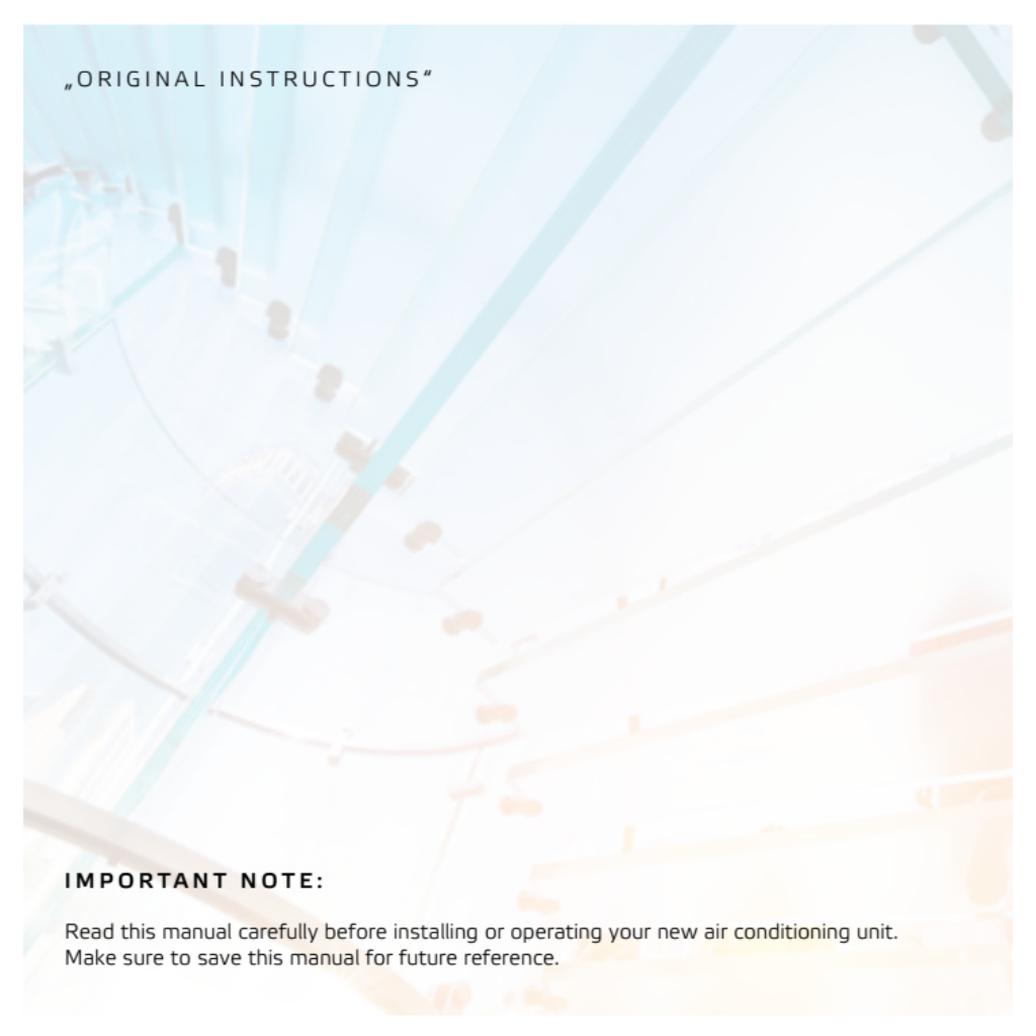

„ORIGINAL INSTRUCTIONS“

IMPORTANT NOTE:

Read this manual carefully before installing or operating your new air conditioning unit.
Make sure to save this manual for future reference.

To Users

Thank you for selecting Sinclair product. Please read this instruction manual carefully before installing and using the product, so as to master and correctly use the product. In order to guide you to correctly install and use our product and achieve expected operating effect, we hereby instruct as below:

- (1) This appliance is not intended for use by persons (including children) with reduced physical, sensory or mental capabilities, or lack of experience and knowledge, unless they have been given supervision or instruction concerning use of the appliance by a person responsible for their safety. Children should be supervised to ensure that they do not play with the appliance.
- (2) This instruction manual is a universal manual; some functions are only applicable to particular product. All the illustrations and information in the instruction manual are only for reference, and control interface should be subject to actual operation.
- (3) In order to make the product better, we will continuously conduct improvement and innovation. If there is adjustment in the product, please subject to actual product.
- (4) If the product needs to be installed, moved or maintained, please contact our designated dealer or local service center for professional support. Users should not disassemble or maintain the unit by themselves, otherwise it may cause

relative damage, and our company will bear no responsibilities.



This marking indicates that this product should not be disposed with other household wastes throughout the EU. To prevent possible harm to the environment or human health from uncontrolled waste disposal, recycle it responsibly to promote the sustainable reuse of material resources. To return your used device, please use the return and collection systems or contact the retailer where the product was purchased. They can take this product for environmental safe recycling.

Contents

1 Safety Notices (Please be sure to abide them)	1
2 Operation Notices.....	1
3 Display.....	3
3.1 LCD of Wired Controller	4
3.2 LCD Display Instruction.....	4
3.3 Instruction of Status Column Icons.....	5
4 Button.....	7
4.1 Button Silk Screen.....	7
4.2 Buttons Function Instruction	7
5 Installation and Commissioning	8
5.1 Instruction of Wired Controller.....	9
5.2 Engineering Debugging.....	15
6 Operation Instruction	28
6.1 ON/OFF.....	28
6.2 Mode Setting	29

6.3 Temperature Setting	30
6.4 Fan Setting	32
6.5 Swing Setting	33
6.6 Function Setting	34
6.7 Universal Setting	52
6.8 Timer Setting	55
7 Error Display	61
7.1 Table of Display Codes for UNI split 2.....	73

1 Safety Notices (Please be sure to abide them)



WARNING: If not abide them strictly, it may cause severe damage to the unit or the people.



NOTE: If not abide them strictly, it may cause slight or medium damage to the unit or the people.



This sign indicates that the items must be prohibited. Improper operation may cause severe damage or death to people.



This sign indicates that the items must be observed. Improper operation may cause damage to people or property.



WARNING!

This product can't be installed at corrosive, inflammable or explosive environment or the place with special requirements, such as kitchen. Otherwise, it will affect the normal operation or shorten the service life of the unit, or even cause fire hazard or serious injury. As for the above special places, please adopt special air conditioner with anti-corrosive or anti-explosion function.

2 Operation Notices

- ◆ The power supply for all indoor units must be unified.
- ◆ Prohibit installing the wired controller at wet or sunshine places.
- ◆ Do not knock, throw or frequently disassemble the wired controller.
- ◆ Do not operate the wired controller with wet hands.
- ◆ This product is applicable UNI split 2 unit whose outdoor unit and indoor unit communicate with each other by live line and neutralline.

- ◆ When two wired controllers control one (or more) indoor unit(s), the address of wired controller should be different.
- ◆ Functions with “*” are optional for indoor units. If a function is not included in an indoor unit, wired controller can't set the function, or setting of this function is invalid to the indoor unit.

- ◆ Hereby, Our company, declares that this product is in compliance with the essential requirement and other relevant provisions of RE Directive 2014/53/EU. Wireless frequency range: 2412MHz - 2472MHz. Maximum Transmit Power: 18dBm.

3 Display

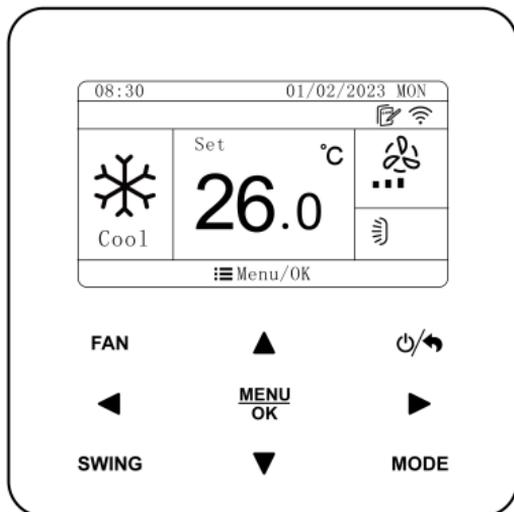


Fig. 3.1 Appearance of wired controller

3.1 LCD of Wired Controller

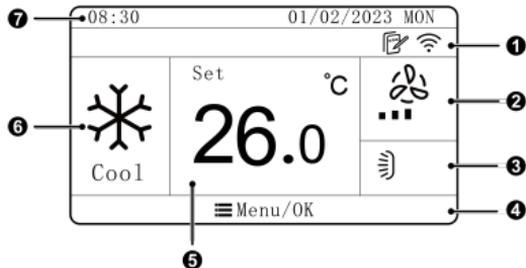


Fig. 3.2 LCD graphics of wired controller

3.2 LCD Display Instruction

Table 3.1 LCD display instruction

No.	Name	Instruction
1	Status column	Display the icon of function that is turned on
2	Fan speed	It is for displaying the fan speed
3	Swing	It is for displaying the current swing status
4	Button prompt	Display the function of menu/ok button at the current page and the settable cursor
5	Temperature display	It shows the value of temperature (If the wired controller is controlling a fresh air indoor unit, it will display FAP).
6	Mode	It shows the operating mode
7	Clock display	It display the date and the time. When it's locating the indoor unit, it displays the project No. of current indoor unit.

No.	Name	Instruction
NOTE: When wired controller is connected with different indoor units, some functions will be different.		

3.3 Instruction of Status Column Icons

Table 3.2 Instruction of Status Column Icon

No.	Symbols	Name	Instructions
1		Air *	Air status(indoor unit optional function)
2		Remove card	The card for access control is removed
3		Clean	Remind to clean the filter
4		Child lock	Child lock status
5		Error	There are errors for the unit
6		Health *	Health function (indoor unit optional function)
7		Defrosting	Defrosting status of outdoor unit
8		Master	Current wired controller connects the master indoor unit.
9		Power off memory	Memory status (when power recovered, indoor unit will resume previous setting status)
10		Absence	Absence is displayed when this function is turned on.

No.	Symbols	Name	Instructions
11		Quiet status	Quiet status (including quiet and auto quiet modes)
12		Energy-saving	Energy-saving status of indoor unit
13		Shield	Shielding status
14		Slave wired controller	Slave wired controller (address of wired controller is 02).
15		Sleep	Sleep status
16		Time	Timer status is displayed
17		X-fan	X-fan is displayed when this function is set.
18		Group control	One wired controller controls multiple indoor units.
19		Valid operation	It's displayed for valid operation
20		WiFi	WiFi status
21		Independent swing*	Independent swing status
22		Auto clean *	Auto clean status
23		I-DEMAND*	I-DEMAND function, Indoor unit optional function.

No.	Symbols	Name	Instructions
24		DRED*	DRED gear control status
25		Setback	Setback function status

NOTE: When wired controller is connected with different indoor units, some functions will be different.

4 Button

4.1 Button Silk Screen

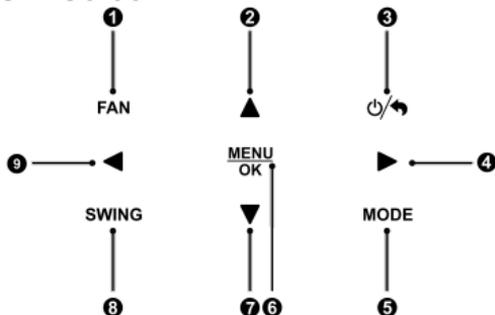


Fig. 4.1 Button silk screen

4.2 Buttons Function Instruction

Table 4.1 Buttons function instruction

No.	Name	Function
1	Fan	Switch fan speeds: auto, low, medium-low, medium, Medium-high and high

No.	Name	Function
2	▲	(1) Set operation temperature for the indoor unit. (2) Move cursor.
7	▼	(3) Set and check parameters.
3	⏻/↶	On/off button for turn on or turn off the unit; back button for return to previous page.
9	◀	(1) Turn pages, and switch and select the target; (2) Move the cursor;
4	▶	(3) Set and check parameters.
5	Mode	Switch operating modes: Auto, Cool, Dry, Fan, Heat, Floor, 3D Heat, etc.
6	Menu/OK	Select mode and confirm parameters.
8	Swing	Set the swing status of central air conditioners.

5 Installation and Commissioning

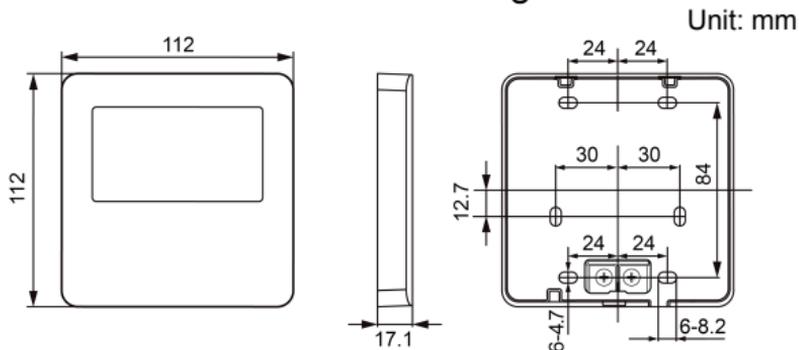


Fig. 5.1 Dimension of Wired Controller

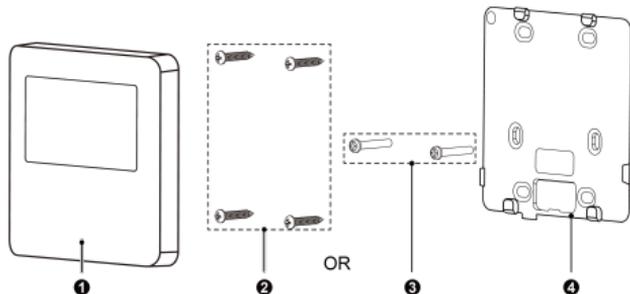


Fig. 5.2 Parts and Components of Wired Controller

No.	1	2	3	4
Name	Panel of wired controller	Self-tapping screw ST3.9×25 MA	Screw M4×25	Soleplate of wired controller
QTY	1	4	2	1

5.1 Instruction of Wired Controller

5.1.1 Requirements for Model Selection of Communication Wire

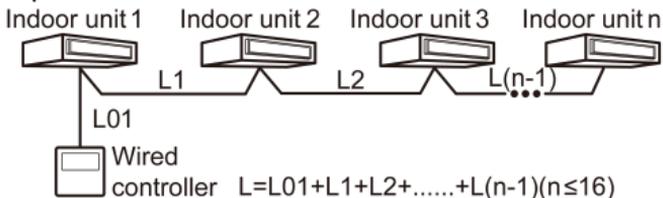


Fig. 5.3 Length of communication wire

Wire material type	Total length L (m/feet)	Wire size (mm ² /AWG)	Material standard	Remarks
Light/ Ordinary Polyvinyl chloride sheathed cord. (60227 IEC 52 /60227 IEC 53)	L≤250m (L≤820- 1/5 feet)	2×0.75 mm ² ~2× 1.25 mm ² (2×AWG18~ 2×AWG16)	IEC 60227- 5:2007	<p>(1) Total length of communication line can't exceed 250m (820-1/5feet).</p> <p>(2) The cord shall be circular cord (the cores shall be twisted together).</p> <p>(3) If unit is installed in places with intense magnetic field or strong interference, it is necessary to use shielded wire.</p>

5.1.2 Requirements for Installation

- (1) It is not allowed to install the wired controller in the wet place.
- (2) It is not allowed to install the wired controller in the place with direct sunlight.

- (3) It is not allowed to install the wired controller near the high-temperature object or the place is likely to be spattered with water.

5.1.3 Requirements for Wired Connection

Network connecting methods between wired controller and indoor unit are as below:

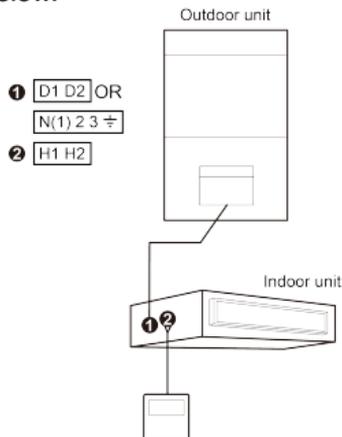


Fig. 5.4 One wired controller controls one indoor unit

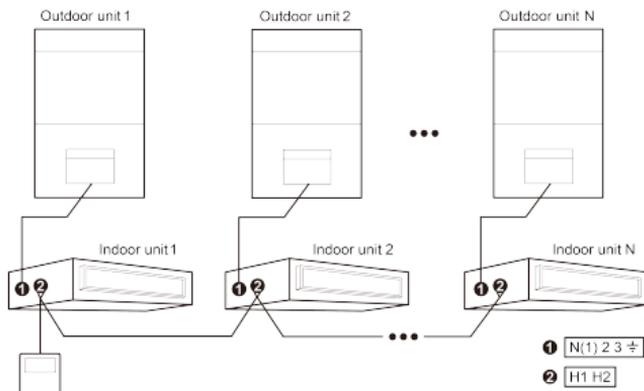


Fig. 5.5 One wired controller controls multiple UNI split 2 units simultaneously

Instruction for wire connection:

- (1) The wiring methods in fig. 5.4 and fig. 5.5 can be adopted for the wired controller connecting UNI split 2 unit.
- (2) When one wired controller controls multiple indoor units simultaneously, the wired controller can connect to any one indoor unit, but the connected indoor unit must be the same series indoor unit. The total quantity of indoor unit controlled by wired controller can't exceed 16 sets, and the connected indoor unit must be within the same indoor unit's network. Wire controller must set quantity of group control indoor units. Please refer to 5.2.2 Parameter Setting.
- (3) The terminal of the wire controller is non-polarized and cannot be connected to strong electric.

NOTE: Wired controller SWC-07 only supports one (or more) indoor unit(s) controlled by one wired controller.

5.1.4 Installation

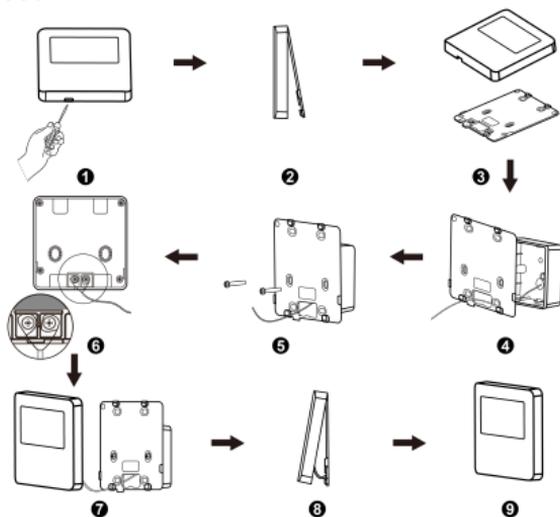


Fig. 5.7 Installation of Wired Controller

Fig. 5.7 shows a simple installation course of wired controller, and the following points should be noted:

- (1) Before installation, please cut off the power supply of indoor unit, it is not allowed to operate with power supply;
- (2) Pull out the 2-core twisted pair inside the installation hole in the wall, and thread the wire through the hole in the back of soleplate of wired controller;
- (3) Stick the soleplate of wired controller on the wall, and use Self-tapping Screw ST3.9×25 MA or screw M4×25 to fix the soleplate with the installation hole of wall;
- (4) Connect the 2-core twisted pair to wiring terminal H1 and H2, and then tighten the screw;
- (5) Arrange the wires in the back of panel, and then buckle the panel of wired controller with the soleplate of wired controller.

5.1.5 Disassembly

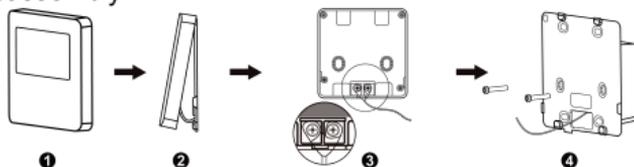


Fig. 5.8 Disassembly of wired controller


5.2 Engineering Debugging

5.2.1 Parameter View

Under on or off status, view unit's parameters.


Press "Menu/OK" button on the home page to enter into the

menu page to select “View” to go to view page shown as below:

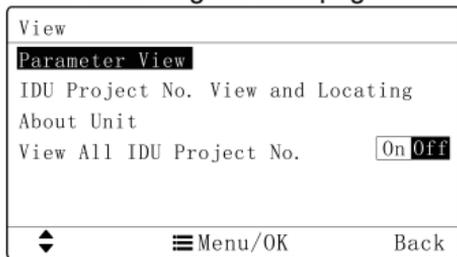

(1) View and locate indoor unit project No.

Select “IDU Project No. View and Locating” on the view page to go to indoor unit project No. view and locating page shown as below. Indoor unit project No. and error codes will be displayed on this page.

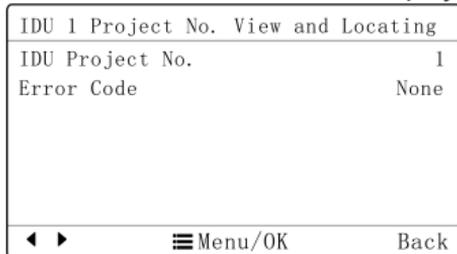

If there are multiple indoor units, press “◀” or “▶” button to switch the indoor unit. Corresponding indoor unit project No. and current errors will be displayed. When one indoor unit has multiple errors, the error codes will be displayed circularly at the interval of 3s. If there is

no error, “none” will be displayed.

After entering indoor unit project No. View and locating page, the buzzer of selected indoor unit gives out sound until exit from the view page or switch to the next indoor unit.

(2) Parameter View

Select “parameter view” at the view page to enter into parameter view page shown as below. As for the parameters, please refer to table 5.1 “Unit parameters view list”.

Parameter View	1-9
Wired Controllers Address	1
Number of IDUs	1
Master IDUs Project No.	1
Time Left to Clean Filter	30Days
Online IDUs of CAN1	0
CAN2 Address	--
◆	☰ Menu/OK Back

When viewing the indoor unit, if there are multiple indoor unit, press “◀” or “▶” button to switch indoor units. Corresponding indoor unit’s parameters will be displayed on the page. See the figure as below:

IDU1	3-9
IDU Error Log	L5,L5,L5,E0,E0
Prior Operation	No
Indoor Temp	26°C
Relative Humidity/RH	66%
Inlet Temp 1	--°C
Outlet Temp 1	--°C
◆	☰ Menu/OK Back

When viewing the outdoor unit, if there are multiple outdoor unit, press “◀” or “▶” button to switch outdoor units. Corresponding outdoor unit’s parameters will be displayed on the page. See the figure as below:

ODU1	6-9
ODU Static Pressure	--Pa
ODU Error Log	--
Outdoor Temp	26℃
Comp1 Operation Freq	40Hz
Comp2 Operation Freq	40Hz
ODU Fan Operation Freq	40Hz
◀ ▶	☰ Menu/OK Back

Table 5.1 Unit parameters view list

Parameter Name	Range	Parameter Name	Range
Wired Controller's Address	1,2	Number of IDUs	1~16
Master IDU's Project No.	0,1~255	Time Left to Clean Filter	0~416 days
Online IDUs of CAN1	1~100	CAN2 address	1~255
Max Distribution Ratio	110% 135% 150%	Cool & Heat Modes	Cool Only, Heat Only, Cool & Heat, Fan
IDU Error Log	5 historical errors	Prior Operation	Yes, No

Parameter Name	Range	Parameter Name	Range
Indoor Temp	-30°C -139°C	Relative Humidity / RH	0%~100%
Inlet Temp 1	-30°C -139°C	Outlet Temp 1	-30°C -139°C
Inlet Temp 2*	-30°C -139°C	Outlet Temp 2*	-30°C -139°C
IDU Capacity	IDU capacity and capacity after adjustment	IDU EXV Status	0~20
Fresh Air IDU Output Temp*	-30°C -139°C	ODU Static Pressure	0, 20, 50, 80
Duct Network Static Pressure	0~999	ODU Error Log	5 historical errors

The following parameters can only be viewed from the master wired controller, they cannot be viewed from the slave wired controller

Parameter Name	Range	Parameter Name	Range
Unit Code	0~9, A~Z, a~z, -	Board Code	0~9, A~Z, a~z,-
Outdoor Temp	-30~139°C	Comp1 Operation Freq.	0~200Hz
Comp 2 Operation Freq.	0~200Hz	ODU Fan Operation Freq.	0~100Hz
Module High Pressure	-40~70°C	Module Low Pressure	-69~38°C
Comp1 Discharge Temp	-30~150°C	Comp 2 Discharge Temp.	-30~150°C

The following parameters can only be viewed from the master wired controller, they cannot be viewed from the slave wired controller			
Parameter Name	Range	Parameter Name	Range
Comp 3 Discharge Temp	-30~150°C	Comp 4 Discharge Temp.	-30~150°C
Comp 5 Discharge Temp	-30~150°C	Comp 6 Discharge Temp.	-30~150°C
Comp 3 Operation Freq.	0~200Hz	ODU Heating EXV1	0~48
ODU Heating EXV2	0~48	Subcooler EXV	0~48
Defrosting Temp	-30~139°C	Subcooler Liquid Temp	-30~139°C
Separator Outlet Temp	-30~139°C	Oil Return Temp	-30~139°C
Condenser Inlet Temp	-30~139°C	Condenser Outlet Temp	-30~139°C

NOTES:


- ① Under parameter viewing status, the signal from remote controller is invalid.
- ② When the parameter is invalid, it will display "--".

5.2.2 Parameters Setting


Parameters can be set under on or off status.

Press "Menu/ok" button on the homepage to enter into menu page to select "set" to go to set page. Select "parameter setting" at

the set page to go into parameter setting page. See the figure as below.

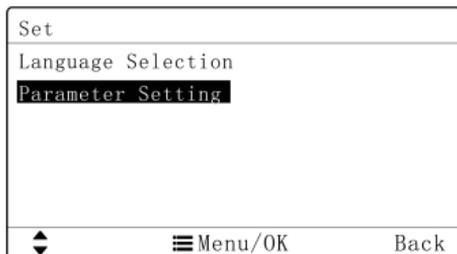

Select user parameter, project parameter and UNI split 2 parameter to enter into corresponding parameter setting. See the figure as below:

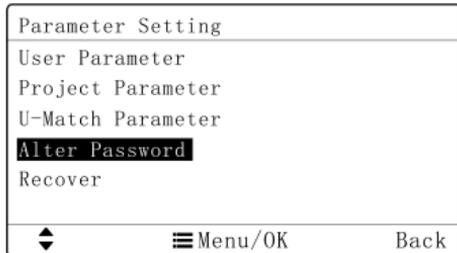

After that, press “▲” or “▼” button to switch the items. Hold it can switch it quickly.

When selecting the parameter, press “◀” or “▶” to switch the setting value. Press “menu/ok” button to save corresponding setting

items. If the setting can't be confirmed, switching the item can restore the previous setting value.

User Parameter		
Master Wired Controller	Yes	
Master IDU	Yes	
Use Remote	Yes	
Prior Operation	No	
High Ceiling Installation	No	
Link with Fresh Air IDU	No	
 	 Menu/OK	Back

Please refer to table 5.2 for the settable parameters.

Table 5.2 Unit's parameters setting list

Item	Settable range	Default	Remarks
Master Wired Controller	Yes, No	Yes	When it is set as no, this wired controller is slave wired controller. Status column of the homepage displays the icon of slave wired controller “  ”. The wired controller can only activate the master wired controller. It does not have the function of setting parameters for other units.

Item	Settable range	Default	Remarks
Master IDU	Yes, No	No	Once it is activated, the current IDU is set to be the master IDU. When the setting is Yes, if the system mode priority is the master-slave mode, the status column in homepage will display the icon of master IDU "⌚"; when the setting is off, master and slave status of the current IDU will not be changed.
Use Remote	Yes, No	Yes	When it is set as no, the wired controller cannot receive the remote control signal. It can only be operated with buttons.
Prior Operation	Yes, No	No	When the power supply is insufficient, it is allowed to turn on the designated IDU as preferential operation; other IDUs should be forced to be off.
High Ceiling Installation*	Yes, No	No	Only applicable to cassette type IDU

Item	Settable range	Default	Remarks
Link with Fresh Air IDU*	Yes, No	No	After setting the linkage function, the fresh air IDU will automatically turn on or turn off along with the on and off of general IDU. Meanwhile, users can manually turn on or turn off the unit. It only applicable to fresh air IDU.
PM2.5 Filter*	Yes, No	No	After it is successfully set, adjust the revolving speed to ensure the air volume is close to or the same as the previous air volume. It is only applicable to the unit with PM2.5 filter.
Temp and RH Correction Control	Yes: Temp and humidity correction control No: Ambient temperature control	Refer to indoor unit for the defaulted value	It can be set only when it's supported by the indoor unit.

Item	Settable range	Default	Remarks
Dry Mode Humidity Control	Yes: Humidity control No: Temperature control	No	If select "yes", set humidity is displayed under dry mode. Otherwise, set temperature is displayed. It can only be set when it's supported by the indoor unit.
Clear Filter Cleaning Time	Yes, No	No	—
Indoor Fan Static Pressure	1~9	5	
Number of IDUs	0: This function is unavailable 1-16: quantity of IDU	1	Set corresponding value according to the connected quantity of IDU.
Angle of Air-return Board*	Angle 1 Angle 2 Angle 3	Angle 2	Only applicable to the model with air-return plate.
Cooling temp of Auto Mode	17°C~30°C	25°C	Cooling temperature of auto mode - heating temperature of auto mode $\geq 1^\circ\text{C}$.
Heating temp of Auto Mode	16°C ~29°C	20°C	

Item	Settable range	Default	Remarks
Resume After Inserting Card	Yes, No	Yes	When it is set as No, it will keep the status after inserting the gate control card. If it is at OFF status when pulling out the card, when inserting the card, it is still at OFF status.
Time for IDU Cold Air Prevention*	180s, 300s, 420s, 600s	180s	Cold air prevention time is the max waiting time from the time turning on the heating mode to the time blowing out the hot wind. The actual waiting time is related to the outdoor ambient temperature. If there is cold air after turning on the heating mode in the actual operation, please consult the professional person to adjust this parameter.
Set Temp of RH Control Mode	10°C ~30°C	16°C	Note: It's only applicable for the units whose dry mode is with humidity control function.

Item	Settable range	Default	Remarks
Auto Clean Mode	01: Normal 02: Quick 03: Deep	1	NOTE: Only applicable to the unit with auto clean function. If "0" is displayed, this function is not available for this unit.
Cooling Temp of Fresh Air IDU*	16°C ~30°C	18°C	Only applicable to fresh air IDU.
Heating Temp of Fresh Air IDU*	16°C ~30°C	22°C	Only applicable to fresh air IDU.

NOTES:

- ① Except for the above parameters, setting interface for other parameter can only be accessed by inputting password.
- ② Under parameter setting status, the signal from remote controller is invalid.
- ③ Under some circumstances, invalid parameters setting is in grey. Press "▲" or "▼" button to skip this parameter setting.

6 Operation Instruction

6.1 ON/OFF

Press "⏻/↻" button to turn on the air conditioner.

Press "⏻/↻" button again to stop operation.

ON and OFF interfaces are shown as below:

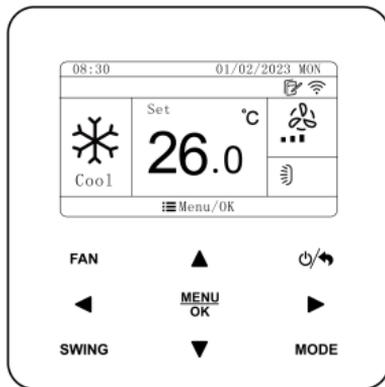



Fig. 6.1 ON interface




Fig. 6.2 OFF interface

6.2 Mode Setting

Under On status, pressing “MODE” button can set modes circularly:



OR



NOTES:

- ① The available modes are different for different models. The wired controller will automatically select mode setting range according to the model of indoor unit.
- ② Under Auto mode, if the indoor unit is cooling, the icons “

6.3 Temperature Setting

Press “▲” or “▼”button under on status to increase or decrease set temperature by 0.5°C/1°C or 1°F; hold “▲” or “▼”button to increase or decrease set temperature by 0.5°C/1°C or 1°F every 0.3s. Please refer to 6.7.4 for the setting method of the temperature setting interval in Celsius.

Under Dry mode, when temperature is 16°C or 61°F, continuously press “▼”button twice to decrease temperature to 12°C or 54°F (when save function is activated, the temperature under Dry mode can't be adjusted to 12°C or 54°F).

When the control method under Dry mode is humidity control, press “▲” or “▼”button to adjust the set humidity at 5% intervals. The humidity setting range is 45%~75%, and the default value is 65%. The humidity control method under Dry mode can only be set for the

unit with this function. Please refer to 5.2.2 Parameter Setting for the setting method.

NOTES:

- ① Only when the wired controller controls UNI split 2 indoor units, the setting temperature can be adjusted by pressing “▲” or “▼” under Auto mode.
- ② When Absence function is activated, the setting temperature cannot be adjusted by pressing “▲” or “▼”.

6.4 Fan Setting

Under On status, pressing “FAN” button can set fan speeds circularly as:



NOTES:

- ① Under Dry mode, fan speed is low and can't be adjusted.
- ② When the wired controller is connected with a Fresh Air Indoor Unit, fan speed of indoor unit will be high fan speed only. Fan speed of indoor unit can't be adjusted via “FAN” button.
- ③ If indoor unit's fan speed is set auto, indoor unit will change fan speed automatically according to room temperature in order to make the room temperature more stable and comfortable.

6.5 Swing Setting


(1) Up&down Swing :

The up&down swing has two modes: simple swing and fixed-angle swing. Select the fixed-angle swing on the function page, and press “◀” and “▶” buttons to turn on or turn off the fixed-angle swing. Simple swing and fixed-angle swing can be switched.

Under on status, press “Swing” button on the homepage to enter into swing setting:

1) When the simple swing is set, press “Swing” button to turn on or turn off the up&down swing.

2) When the fixed-angle swing is set, press “Swing” button to switch swing statuses circularly as below:




(2) Left&right swing*:

The left&right swing has two modes: simple swing and fixed-angle swing. Select the fixed-angle swing on the function page, and press “◀” and “▶” buttons to turn on or turn off the fixed-angle swing. Simple swing and fixed-angle swing can be switched.

Under on status, press “Swing” button on the homepage to enter into swing setting, and then press “◀” and “▶” button to switch to the left&right swing setting:

- 1) When the simple swing is set, press “Swing” button to turn on or turn off the left&right swing.
- 2) When the fixed-angle swing is set, press “Swing” button to switch swing statuses circularly as below:



6.6 Function Setting

Press “Menu/OK” button on the homepage to enter menu page and then select “Function” to go to function page. See the figure as below.

Function	1-3
Turbo	ON OFF
Air	ON OFF
Sleep	ON OFF
Health	ON OFF
I-Demand	ON OFF
Absence	ON OFF
	Back

Fig. 6.3 Function page

Press “▲” or “▼” button to switch the items; press “◀” and “▶” button to turn on or turn off corresponding function. “ON” indicates the function is turned on; “OFF” indicates the function turned off; press “Back” button to turn back to previous page.

Some functions are with more parameters and “Menu/OK” button can be used for setting detailed parameters.

Function	1-3
 Turbo	<input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF
 Air	<input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF
 Sleep	<input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF
 Health	<input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF
 I-Demand	<input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF
 Absence	<input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF
	 Menu/OK Back

Fig. 6.4 Function with detailed setting

As for some functions, only the on/off status is displayed at the switch button. It needs to press “Menu/OK” button to enter into detailed setting:

Function	2-3
 Save	<input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF
 E-heat	<input type="checkbox"/> OFF
 X-fan	<input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF
 Clean Remind	<input type="checkbox"/> OFF
 Quiet	<input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF
 Fixed-angle Swing	<input type="checkbox"/> ON <input checked="" type="checkbox"/> OFF
	 Menu/OK Back

Fig. 6.5 Functions whose on/off status is only displayed

NOTES:

The function under some circumstances is invalid and displayed in grey. Press “▲” or “▼” button to skip this function.

6.6.1 Turbo Setting

Turbo fan Function: Turn on the highest fan speed, and then turbo fan will be displayed on the homepage.

Turn on turbo fan Function: Under on status, select turbo fan on the function page and press “◀” or “▶” button to turn on or turn off the turbo fan. When turbo fan is turned on, “turbo fan” will be displayed at the fan speed area on the homepage.

Cancel turbo fan Function: Same as the method used for turning on the turbo Fan Function.

You can also press “Fan” button on the home page to cancel the turbo fan and then switch to the auto fan.

NOTES:

- ① Under Dry mode, fan speed is low and can't be adjusted.
- ② When the wired controller is connected with a Fresh Air Indoor Unit, fan speed of indoor unit will be high fan speed only. Fan speed of indoor unit can't be adjusted via “FAN” button.
- ③ If indoor unit's fan speed is set auto, indoor unit will change fan speed automatically according to room temperature in order to make the room temperature more stable and comfortable.

6.6.2 Air Setting*

Air Function: Adjust the amount of indoor fresh air to improve air quality and keep indoor air fresh.

Turn on air function: Under on or off status, select the air function on the function page and then press “◀” or “▶” button to turn on or turn off the air function.

Cancel air function: Same as the method used for turning on the air function.

When selecting the air function on the function page, press “Menu/OK” button to go air level setting. The display is as below:

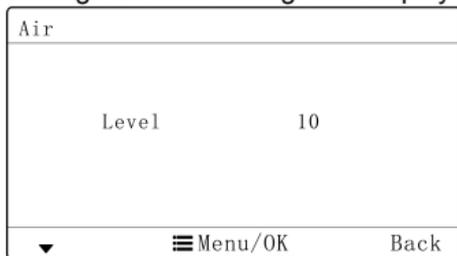


Fig. 6.6 Air level setting

Press “▲” or “▼” button can adjust the air level in the range of level 1~10. Press “Menu/OK” button to save the setting.

NOTES:

- ① Air function is only effective for units with air function and fresh air motorized air valve (abbr. fresh air valve).
- ② The following table indicates the opening time of fresh air valve per unit of time (60 min) corresponding to the level of air setting. Opening time of fresh air valve is the initial N minutes per unit of time. Example: The level of air setting is set to 1, and then unit starts timing and fresh air valve is open. 6 minutes later, fresh air valve is closed and the unit keeps running. After timing for 60 minutes, unit restarts timing and fresh air valve is open again. 6 minutes later, the valve is closed and the cycle repeats.

Level of Air setting	1	2	3	4	5	6	7	8	9	10
Opening time of fresh air valve	60 /6	60 /12	60 /18	60 /24	60 /30	60 /36	60 /42	60 /48	60 /54	Always on

NOTE: Time indicated in the table: unit's operating time (min) / opening time of fresh air valve per operating time (min).

6.6.3 Sleep Setting

Sleep Function: The unit will operate according to the preset sleep curve to provide comfortable sleep environment.

Turn on sleep function: Under on status, select sleep function on the function page and then press “◀” or “▶” to turn on or turn off the sleep function.

Cancel sleep function: Same as the method used for turning on the sleep function.

When sleep function is activated, “☾” icon is bright; quiet or auto quiet mode is also activated.

Under Auto, Fan or Floor Heating mode, the sleep function is not available.

6.6.4 Health Setting*

Health function: Control the air purification module which can purify the air. This function cannot be used under Floor Heating mode.

Turn on health function: Under on status, select the health function on the function page and then press “◀” or “▶” to turn on or turn off the health function.

Cancel health function: Same as the method used for turning on

the health function.

6.6.5 I-Demand Setting*

I-DEMAND function: The unit operates in the SE mode to save energy. I-DEMAND function can only be used under cooling mode.

Turn on I-Demand function: When the unit is turned on, under cooling mode, select I-Demand on the function page, and then press “◀” or “▶” button to turn on or turn off I-Demand function.

Cancel I-Demand function: Same as the method used for turning on the I-Demand function.

NOTE: It is only applicable to UNI split 2 unit.

6.6.6 Absence Setting

Absence function: This is used to maintain indoor temperature so that unit can realize fast heating after it is turned on. This function can only be used under heating mode.

Turn on absence function: Under heating mode, select absence function on the function page and then press “◀” or “▶” button to turn on or turn off the absence function.

Cancel absence function: Same as the method used for turning on the absence function.

6.6.7 Save Setting

Save function: Air conditioner can be operated in small temperature range by setting the minimum temperature under Cooling and Dry modes and setting maximum temperature under Heating, 3D Heating and Space Heating modes. Thus, energy saving can be realized.

Turn on save mode: Under on status, select save function on the function page and press “◀” or “▶” button to turn on or turn off the save function.

Cancel save mode: Same as the method used for turning on the save function.

When selecting save function on the function page, press “Menu/OK” button to set temperature for save function. The display is as below:

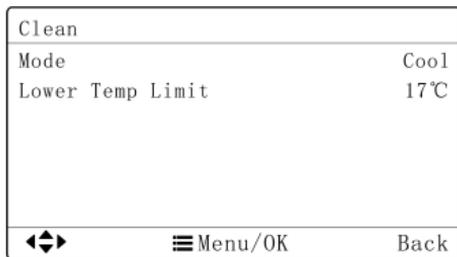


Fig. 6.7 Temperature setting for save function

Press “▲” or “▼” button to switch items. When selecting the first item, press “◀” or “▶” button to switch modes; when selecting the second item, press “◀” or “▶” button to switch temperature lower limit and upper limit value. Press “Menu/OK” button to save the setting and then turn back to the previous page.

When save function is turned on, icon “Ⓢ” is displayed under all modes at on and off statuses.

NOTE:

When the save function is turned on and then set temperature exceeds the limit value for save function, “Ⓢ” icon blinks three times and then buzzer will give out two sounds successively.

6.6.8 X-FAN Setting

X-fan function: If the unit is turned off under Cooling or Dry mode, the evaporator of indoor unit will be dried off automatically to prevent bacteria and mould from gathering.

Turn on X-fan function: When the unit is turned on, select X-fan function on the function page under cooling or dry mode and press “◀” or “▶” button to turn on or turn off X-fan function.

Cancel X-fan: Same as the method used for turning on the X-fan function.

6.6.9 Filter Clean Reminder Setting

Filter Clean Reminder Function: The unit will remember its own operating time. When the setting time is over, this function will remind you to clean the filter. A dirty filter will result in bad heating and cooling performance, abnormal protection, bacteria gathering, etc.

Select “Clean Remind” on the function page and press “Menu/OK” button to go to filter clean reminder setting page. Refer to the figure as below:

Clean	
Clean Remind	Off
Current Cleanliness	1
Clean Cycle	5500
<div style="display: flex; justify-content: space-between; align-items: center;"> ◀▶ ☰ Menu/OK Back </div>	

Fig 6.8 Filter clean reminder setting

Press “▲” or “▼” button to switch items. When selecting the first item, press “◀” or “▶” button to turn on or turn off this function; when selecting the second item, press “◀” or “▶” button to switch current environmental cleanliness (switch among level 1, level 2 and level 3. There are for good, general and bad cleanliness) ; when selecting the third item, press “◀” or “▶” button to adjust the cleaning period . Press “Menu/OK” button to save the setting and then turn back to the previous page.

There are four circumstances while cleaning period Setting:

Turn off clean reminder;

Light pollution: When current cleanliness is “1”, the setting range for the clean cycle is 5500h-10000h. After each pressing of “▶” button, the accumulated time will increase 500h. When the time exceeds the

maximum value, it will turn back to the minimum value.

Medium pollution: When current cleanliness is “2”, the setting range for the clean cycle is 1400h-5000h. After each pressing of “▶” button, the accumulated time will increase 400h. When the time exceeds the maximum value, it will turn back to the minimum value.

Serious pollution: When current cleanliness is “3”, the setting range for the clean cycle is 100h-1000h. After each pressing of “▶” button, the accumulated time will increase 100h. When the time exceeds the maximum value, it will turn back to the minimum value.

NOTES:

When clean time is reached, icon “” at the status column will be displayed. The reminding will pop up at the home page to remind users to clean the filter. Click “Done” or “Skip” to cancel the display. At the same time, the accumulated time for “filter clean reminder” will be cleared and the time will be counted again.

6.6.10 Quiet Setting

Quiet function: Decrease the noise of indoor unit and achieve the quiet effect. Quiet function has two modes: quiet mode and auto quiet mode. It is available only in Auto, Cooling, Dry, Fan, Heating, 3D heating and Space heating modes.

Turn on quiet function: Under on status, select the quiet function on the function page and press “◀” or “▶” button to turn on or turn off the quiet function.

Cancel quiet function: Same as the method used for turning on the quiet function.

When selecting quiet function on the function page, press “Menu/OK” button to set the quiet mode. The display is as below:

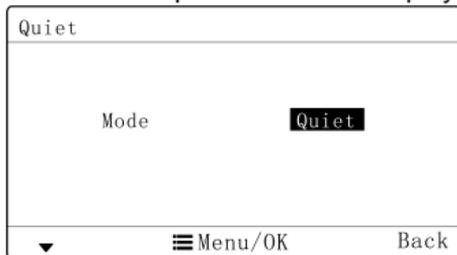


Fig. 6.9 Quiet mode setting

Press “▲” or “▼” button can adjust the quiet mode (quiet mode and auto quiet mode). Press “Menu/OK” button to save the setting.

NOTES:

- ① When quiet function is enabled, indoor unit will operate at quiet fan speed. Fan speed is lowered so as to reduce the noise of indoor fan motor.
- ② When auto quiet function is enabled, indoor unit will change fan speed automatically according to room temperature. After room temperature reaches a set point, the unit will operate at quiet fan speed.

6.6.11 Low-temperature Dry Function Setting

Low-temperature dry function: It can be turned on under the dry mode. When the dry function is turned on, the set temperature is changed to 12°C.

Turn on low-temperature dry function: When the unit is turned on,

under dry mode, select the “12-Drying” function at the function page and then press “◀” or “▶” button to turn it on or turn it off.

Cancel low-temperature dry function: Same as the method of turning on the low-temperature dry function.

6.6.12 Setback Function

In unit off status with setback function activated, the unit will operate in heating mode automatically when indoor temperature is lower than temperature lower limit for setback function and operate in cooling mode automatically when indoor temperature is higher than temperature upper limit for setback function, so as to keep indoor temperature within the temperature upper and lower limit range for setback function.

When turning on the setback function, the icon “” will be displayed on the homepage.

Under off status, when setback function is operating, the icon “” blinks.

As for setting related parameters of setback, it needs to go to user parameters page. Please refer to 5.2.2 parameters setting for the method.

Turn on setback function: Under on or off status, select setback function on the user parameter page, and press “◀” or “▶” button to turn on or turn off the setback function. Press “Menu/OK” button to save the setting.

Cancel setback function: Same as the method used for turning on the setback.

Set setback temperature:

Setback Upper Temp Limit: select “Upper Temp Limit of Setback” on the user parameters page, and press “◀” or “▶” button to adjust the upper temperature limit of setback function. Press “Menu/OK” button to save the setting.

Setback Lower Temp Limit: select “Lower Temp Limit of Setback” on the user parameter page, and press “◀” or “▶” button to adjust the lower temperature limit of setback function. Press “Menu/OK” button to save the setting.

NOTES:

- ① Setback function is forbidden as defaulted;
- ② When the slave indoor unit is operating in setback function, it cannot operate in the mode which is in conflict with that of master indoor unit.
- ③ If you want to activate setback function, you cannot use the wired controllers of other models as the master wired controller or slave master controller.
- ④ When all shield function of remote monitor or central controller is turned on, the wired controller can't enter or exits from the setback function.
- ⑤ When the unit is operating at setback function, the slave wired controller cannot set save function and doesn't display or receive save setting.

6.6.13 DRED Function Setting *

DRED function: The unit operates under save mode. This function can be turned on under cooling, heating, auto and dry modes.

Turn on DRED function: Under on status, select DRED on the function page and then press “◀” or “▶” button to turn on or turn off DRED function.

Cancel DRED: Same as the method used for turning on DRED function.

When selecting DRED on the function page, press “Menu/OK” button to go to DRED mode setting. The display is as below:

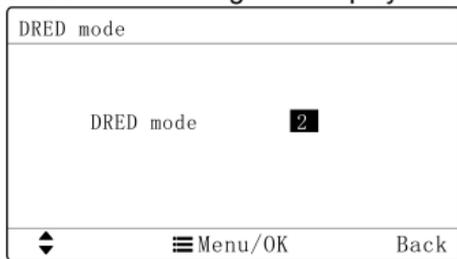


Figure 6.10 DRED mode setting

Press “▲” or “▼” button to switch between DRED mode 2 and DRED mode 3. Press “Menu/OK” button to save the setting.

NOTE: It is only applicable to UNI split 2 unit.

6.6.14 Independent Swing Function Setting*

Turn on independent swing function: Select the independent swing on the function page under on status, and press “◀” or “▶” button

function.

- ③ As for the independent swing, one air outlet at the most can be set closed. When the air outlet is closed, it can't supply the air outlet.
- ④ Turning off the independent swing can restore to the original up&down swing setting.

When independent swing function is turned on, independent swing icon “” will be displayed at the status column on the homepage.

6.6.15 Auto Clean Function*

Turn on auto clean function: Select auto clean function on the function page and then press “◀” or “▶” button to turn on or turn off the auto clean function. When turning on the auto clean function, press other buttons to turn back to the homepage.

Cancel auto clean:

Function page: Same as the method used for turn on the auto clean function.

Homepage: Press any buttons and a pop-up window will appear and then press “” button.

When auto clean function is turned on while the unit hasn't enter into auto clean operation, “” is bright; when the unit has officially entered into auto clean status, “” blinks. The remaining time of auto clean mode is displayed at the temperature area.

When existing the auto clean function, the remaining time for auto clean mode won't be displayed at the temperature area. Some

time later, icon “” will be off and the auto clean is existed.

NOTES:

- ① This function is only applicable to the unit with auto clean function.
- ② When the unit is faulty, auto clean function cannot be turned on.
- ③ When auto clean function is turned on, there will be some phenomenons, such as frosting of evaporator of indoor unit, sound of liquid flow, and fluctuation of indoor temperature and humidity, which will affect the comfort. Auto clean function is recommended to be used when there are no people in the room. In order to ensure the cleaning effect, it is recommended to turn on auto clean function every three months.
- ④ The auto clean effect will be weakened if indoor environment humidity is low.
- ⑤ It is recommended to use auto clean function at the outdoor ambient temperature of 10 °C ~40 °C . Otherwise, auto clean function will exit in advance, which is the normal phenomenon.
- ⑥ When the wired controller controls UNI split 2 unit, auto clean function can only be turned on under OFF status. The remainingtime of the auto clean mode won't be displayed at the timer zone.

6.6.16 Remote Shield Function

Remote shield function: Remote monitor or central controller can disable the relevant functions of wired controller so as to realize the function of remote control.

When the remote monitor or central controller activates remote shield on the wired controller, icon “” will show. If user wants to control it through the wired controller, icon “” will blink to remind that these controls are disabled.

6.6.17 Gate-Control Function

When there is gate-control system, user can insert a card to turn on the unit or pull off a card to turn off the unit. When the card is re-inserted, the unit will recover the operation as state in memory. When the card is pulled off (or improperly inserted), icon “” will show. Neither remote control nor operation of wired controller will be effective and icon “” will blink.

NOTE: This model cannot be connected with gate control system on its own because it cannot detect gate control signal directly. To realize gate control display and gate control function, it has to be used with the wired controller that includes gate control signal detecting function (used as master and slave wired controllers).

6.7 Universal Setting

Press “Menu/OK” button on the homepage to go to the menu page and then select “set” to enter into set page; please refer to the figure as below:

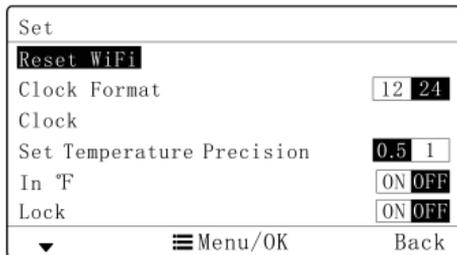


Fig. 6.13 Set page

Below parameters can be set on the set page.

6.7.1 WiFi Function Setting

"EWPE" App can be used to control wired controller SWC-07. Please scan the QR code or search "EWPE" in the application market to download and install it. When "EWPE" App is installed, register the account and add the device to achieve long-distance control and LAN control of Sinclair smart home appliances.

APP can only set some common functions of wired controller: ON/OFF, mode, set temperature, fan speed, etc.

When using the APP for the first time, please reset the WiFi function of wired controller (reset WiFi to ex-factory setting):

Reset WiFi:

Press “Menu/OK” button on the homepage to go to menu page

to select “set” to go to the set page; Select “reset WiFi” on the set page to go to WiFi reset page. Please refer to the figure as below:

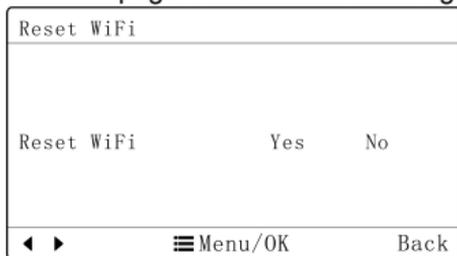


Fig. 6.14 WiFi set page

Press “◀” or “▶” button to select it: “yes” indicates WiFi resetting. When “reset WiFi” on the setting page has changed to “reset succeeded” or WiFi icon on the homepage flashes at the interval of 0.5s, WiFi resetting is succeeded. After that, add devices to the APP.

NOTES:

- ① This function is only applicable to wired controller SWC-07
- ② If the device is offline or router’s name and password have been changed, please reset WiFi and add the device again.
- ③ WiFi networking performance is related to the distance between the wired controller and the router and the obstacles between them. During the installation process, the distance between the wired controller and the router should be as close as possible, and the obstacles should be as little as possible. If the WiFi signal is not good, use the WiFi signal enhanced router. The specific

situation depends on the actual installation.

④ For more information, please refer to "Help" in App.

6.7.2 Time Format Setting

Users can set 12-hour time format or 24-hour time format. Press “▲” or “▼” button on the setting page to select “time format” and then press “◀” or “▶” button to select 12-hour time format or 24-hour time format.

6.7.3 System Time Setting

Select “clock” item on the setting page and then press “Menu/OK” button to go to time setting page. See the figure as below:

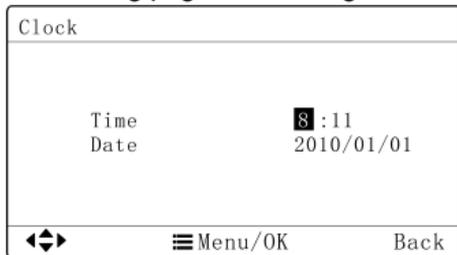


Fig. 6.15 Clock setting page

Press “◀” or “▶” button to select setting items: hour, minute, year, month and day; press “▲” or “▼” button to set the value. When setting is finished, press “Menu/OK” button to save the setting.

6.7.4 Temperature Precision Setting

Users can set the temperature precision as 0.5°C or 1°C. Press “▲” or “▼” button to select “set temperature precision” on the setting

page and then press “◀” or “▶” button to select two different temperature precision.

6.7.5 Temperature Unit Setting

Users can set the temperature unit on the wired controller as °C or °F. Press “▲” or “▼” button to select “In °F” on the setting page; press “◀” or “▶” button to select whether use °F. If not, the temperature unit on the wired controller will switch to °C.

6.7.6 Child Lock Setting

Users can set the child lock on the setting page. When child lock is turned on, other buttons are all invalid. At the same time, LCD flashes to display the icon “” for three times. Users need to unlock it according to the instruction in the pop-up widow. Press “▲” or “▼” to select “lock” on the setting page and then press “◀” or “▶” button to turn on the child lock or not.

6.7.7 Display Language Setting

Users can select the language on the setting page. Press “▲” or “▼” button to select “language selection”; press “menu/OK” button to go to language setting page. Press “▲” or “▼” button to select the required language item. Finally, press “menu/OK” button to save the setting.

6.8 Timer Setting

The wired controller can set four times of timer: daily timer, weekly timer, two-week timer and timer off. Users select the timer icon on the menu page and then press “▲” or “▼” button to select the timer.

Press “◀” or “▶” button to turn on or turn off this timer. Press “Menu/OK” button to go to corresponding timer setting page. The figure is as below:



Fig. 6.16 Timer setting page

6.8.1 Daily Timer Setting

As for the daily timer setting, users can set four independent timer periods. Only when the timer period is turned on, it is valid. As for each timer period, it can set time, on/off, working mode, set temperature and fan speed. See the figure as below:


Daily						
Sch	Time	On/Off	Mode	Temp	Fan	
1	Off	0:00	Off	Cool	20°C	Auto
2	Off	0:00	Off	Cool	20°C	Auto
3	Off	0:00	Off	Cool	20°C	Auto
4	Off	0:00	Off	Cool	20°C	Auto

Fig. 6.17 Daily timer setting page


When entering to daily timer setting page, press “◀” or “▶” button to select the setting item, press “▲” or “▼” button to set the value and then press “Menu/OK” button to save the setting.

6.8.2 Weekly Timer Setting


Users can set the timer for each day in a week, and they can also set 4 timer periods for each day. The unit will execute corresponding timer setting on weekly basis circularly. When entering weekly timer setting page, press “◀” or “▶” button to select one day in a week, press “Menu/OK” button to go to its timer setting, press “▲” or “▶” button to select the item, press “▲” or “▼” button again to adjust the setting content and then press “Menu/OK” button to save the setting. When all timer settings have been saved, press “⏻/↶” button to exit from this page. Please refer to the figure as below:

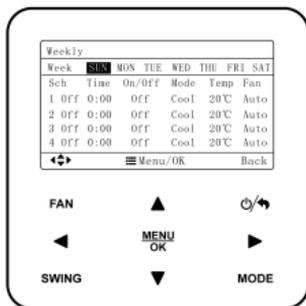


Enter weekly timer setting page

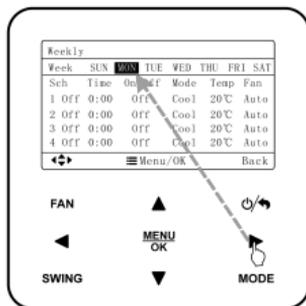


Press "◀" button or "▶" button to select one day in a week to set timer

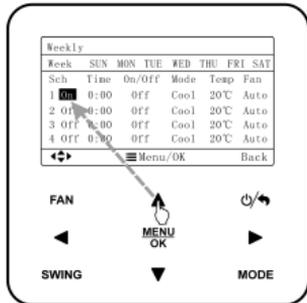

Press "▲" button or "▼" button to adjust the setting content

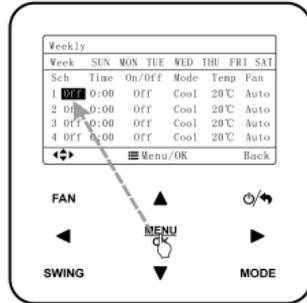

Press "Menu/OK" button to enter timer setting of this day

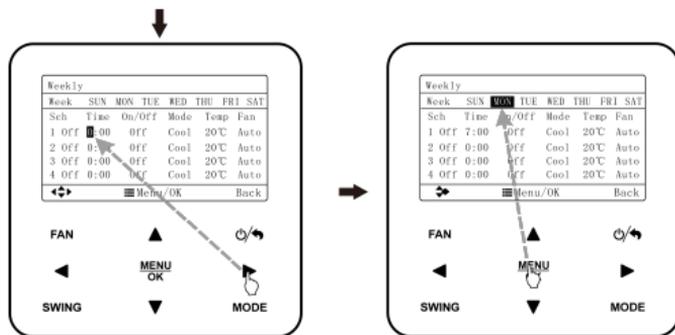

Press "◀" button or "▶" button to switch to the next setting item

When setting is finished, press "Menu/OK" button to save the timer setting for this day, and then the cursor turn back to that day,

Fig. 6.18 Weekly timer setting

When entering to weekly timer setting page, press "◀" or "▶" button to select the setting item, press "▲" or "▼" button to set the value and then press "Menu/OK" button to save the setting.

6.8.3 Two-week Timer Setting

Users can set the timer for each day in two weeks and they can also set 4 timer periods for each day. The unit will execute corresponding timer setting on two-week circularly. Select "two week" on the timer interface and then press "Menu/OK" button to enter into two-week timer menu. Please refer to the figure as below.

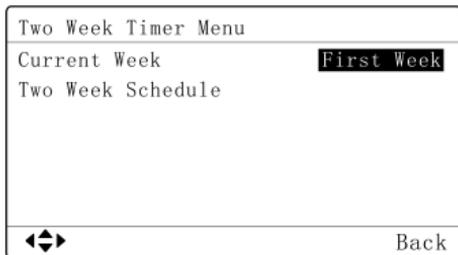


Fig. 6.19 Two-week timer menu

Select the item of “two week schedule”, press “Menu/OK” button to enter into its setting page, select the item of “current week” and then press “◀” or “▶” button can set the current week as the first week or the second week.

When entering two-week timer page, users can press “▲” or “▼” button to select the setting items for two-week time, and then press “Menu/OK” button to go to two-week timer setting page. When entering two-week timer setting page, press “◀” or “▶” button to select one day in two weeks, press “Menu/OK” button to go to its timer setting, press “◀” or “▶” button to select the item, press “▲” or “▼” button again to adjust the setting content and then press “Menu/OK” button to save the setting. Press “⏏/↶” button to exit from this page. Please refer to the figure as the Fig. Weekly timer setting.

6.8.4 Timer OFF Setting

As for timer OFF, the unit will be turned off after operating for “x” hours. If the timer off has been set, when the unit has been turned on

every time, it will be turned off automatically after operation for “x” hours.

When entering timer OFF page, press “▲” or “▼” button to set the time for timer OFF, set the time change at the interval of 0.5h and then press “Menu/OK” button to save the setting. If not save the setting, press “⏪/↶” button turn it back. Please refer to the figure as below.

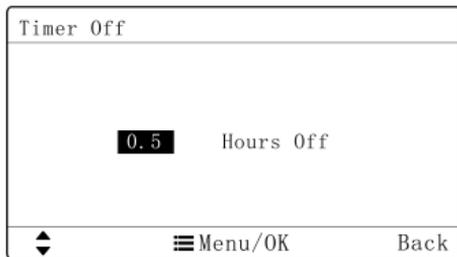


Fig. 6.20 Timer OFF Setting Page

NOTE: The time is 12-hour format. The time on the timer setting page is displayed by 12-hour format.

7 Error Display

When there is error during operation, the temperature display zone on the wired controller will show the error code. If several errors happen at the same time, error codes will show on the display repeatedly.

NOTE: If error occurs, please turn off the unit and ask for professionals to repair it.

Fig.7.1 shows the display of outdoor unit high pressure protection when unit is on.

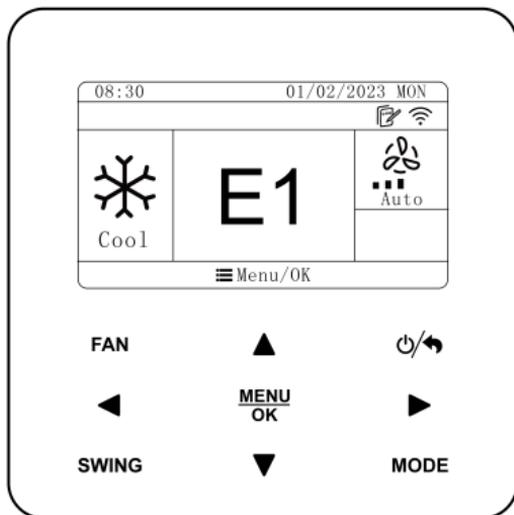


Fig. 7.1 Display of Outdoor Unit High Pressure Protection

7.1 Table of Display Codes for UNI split 2 Unit

7.1.1 Table of Error Codes of Outdoor Unit

Error Code	Content	Error Code	Content
E4	Discharge Protection	LA	Outdoor Fan 2 Error
H4	Overload Protection	L3	Outdoor Fan 1 Error
PA	ODU AC Current Protection	E3	System Low Pressure Protection
H5	Module Current Protection	E1	System High Pressure Protection
P8	Module Temperature Protection	U3	DC Bus Voltage Drop Error
E2	Freeze Protection	U5	Current Detecting Error of Complete Unit
L9	High Power Protection	PU	Capacitor Charging Error
U2	Compressor Phase Loss/Phase Reversal/Out of Phase	U1	Compressor Phase Current Circuit Detecting Error

Error Code	Content	Error Code	Content
HC	PFC Overcurrent Error	H7	Compressor Non-synchronism
PH	High Voltage Protection of DC Bus	HE	Compressor Demagnetization Protection
PL	Low Voltage Protection of DC Bus	LE	Compressor Stalling
Lc	Startup Failure	P6	Drive Board Communication Error
P0	Drive Module Reset	P5	Overcurrent of Compressor Phase Current
LF	Overspeed	PP	DC Input Voltage Error
C8	Compressor DIP Switch/Jumper Cap Error	Uo	Abnormal Outdoor Ambient Temperature (heating at too high ambient temperature or cooling at too low ambient temperature)
PF	Drive Board Ambient Temperature Sensor Error	b5	Liquid Valve Temperature Sensor Error
P9	AC Contactor Protection	b7	Gas Valve Temperature Sensor Error
PE	Temperature Shifting Protection	A5	Outdoor Condenser Inlet Pipe Temperature Sensor Error

Error Code	Content	Error Code	Content
Pd	Sensor Connection Protection (current sensor hasn't been connected to corresponding U phase or V phase)	A7	Outdoor Condenser Outlet Pipe Temperature Sensor Error
e3	Low Pressure Sensor Error	A4	Refrigerant Temperature Sensor Error
C7	Outdoor Pipe Middle Sensor Error	A3	ODU Refrigerant Heater Failure
E1	High Pressure Switch 2 Error	A2	ODU Refrigerant Heater Relay Adhesion Error
C9	Compressor Drive Storage Chip Error	E6	Communication Error between ODU and IDU
Ad	Outdoor Fan Out-of-phase Protection	C4	ODU Jumper Cap Error
AE	Outdoor Fan Current Detecting Circuit Error	dJ	AC Phase Sequence Protection (phase loss or phase reversal)
Ac	Outdoor Fan Startup Failure	e1	High Pressure Sensor Error
AJ	Outdoor Fan Non-synchronism Protection	UL	Outdoor Fan Overcurrent Protection
EL	Emergency Operation Stop	A1	Outdoor Fan IPM Module Protection
oE	Other Error of Compressor	C6	Discharge Temperature Sensor Error

Error Code	Content	Error Code	Content
dc	Compressor Suction Temperature Sensor Error	C3	Outdoor Condenser Middle Pipe Temperature Sensor Error
P7	Module Temperature Sensor Circuit Error	U7	4-way Valve Commutation Error
U8	Zero-crossing Signal Error	Cd	Abnormal Electrical Level of Selected Port
F3	Outdoor Ambient Temperature Sensor Error	EE	Memory Chip Read and Write Error
E3	Refrigerant Lacking Protection	—	—

7.1.2 Table of Error Codes of Indoor Unit

Error Code	Content	Error Code	Content
E0	Indoor Fan Error	L1	Indoor Humidity Sensor Error
qA	Inverter Indoor Fan Drive Current Detecting Circuit Error	qC	Main Control and Inverter Indoor Fan Drive Communication Error
C1	Indoor Ambient Temperature Sensor Error	qd	Inverter Indoor Fan Drive Module High Temperature Protection
C2	Indoor Evaporator Middle Temperature Sensor Error	qE	Inverter Indoor Fan Drive Module Temperature Sensor Error

Error Code	Content	Error Code	Content
E9	IDU Water Full Protection	qF	Inverter Indoor Fan Drive Storage Chip Error
CJ	IDU Jumper Cap Error	qH	Inverter Indoor Fan Drive Charging Circuit Error
q3	Inverter Indoor Fan Drive IPM Module Protection	qL	Inverter Indoor Fan Drive AC Input Voltage Abnormal Protection
q0	Low Voltage Protection or Voltage Drop Error of Inverter Indoor Fan Drive DC Bus	qo	Inverter Indoor Fan Drive Electric Box Temperature Sensor Error
q1	High Voltage Protection of Inverter Indoor Fan Drive DC Bus	qp	Inverter Indoor Fan Drive AC Input Zero-crossing Protection
q2	Inverter Indoor Fan AC Current Protection (input side)	C0	Communication Error between Indoor Unit and Wired Controller
q4	Inverter Indoor Fan Drive PFC Protection	qb	Inverter Indoor Fan Non-synchronism Protection
q5	Inverter Indoor Fan Startup Failure	CP	Multiple Master Wired Controllers Error
q6	Inverter Indoor Fan Out-of-phase Protection	L5	Wired Controller Power Supply Overcurrent Protection
q7	Inverter Indoor Fan Drive Module Reset	L7	Group-controlled IDU Series Inconsistency

Error Code	Content	Error Code	Content
q8	Inverter Indoor Fan Overcurrent Protection	CE	Wired Controller Temperature Sensor Error
q9	Inverter Indoor Fan Power Protection	dH	Wired Controller Circuit Board Error
L4	Wired Controller Power Supply Circuit Failure	Lb	Group-controlled IDU Inconsistency of Reheat Dehumidification System
L6	Group-controlled IDU Quantity Inconsistency	—	—

7.1.3 Table of Status Codes

Status Code	Content	Status Code	Content
CL	Auto clean	d1	DRED operation mode 1
Fo	Refrigerant recycle mode	d2	DRED operation mode 2
H1	Ordinary defrosting status	d3	DRED operation mode 3

NOTE CONCERNING PROTECTION OF ENVIRONMENT



This product must not be disposed of via normal household waste after its service life, but must be taken to a collection station for the recycling of electrical and electronic devices. The symbol on the product, the operating instructions or the packaging indicate such disposal procedures. The materials are recyclable in accordance with their respective symbols. By means of re-use, material recycling or any other form of recycling old appliances you are making an important contribution to the protection of our environment. Please ask your local council where your nearest disposal station is located.

PRODUCER

SINCLAIR CORPORATION Ltd.
16 Great Queen Street
WC2B 5AH London
United Kingdom
www.sinclair-world.com

REPRESENTATIVE

SINCLAIR Global Group s.r.o.
Purkynova 45
612 00 Brno
Czech Republic

This product was manufactured in China (Made in China).

TECHNICAL SUPPORT

SINCLAIR Global Group s.r.o.
Purkynova 45
612 00 Brno
Czech Republic
Tel.: +420 800 100 285 | Fax: +420 541 590 124
www.sinclair-solutions.com | info@sinclair-solutions.com





sinclair

AIR CONDITIONING